

Environmental Certification Scheme

Carpet Name: CROPLANDS


Licensee: ABOVE LEFT
Licence Number: 2001
Label Number: 19004

Certification Approved: 30/08/2017

Level: 4

ACCS Contract Grading: CHD 3*
ACCS Residential Grading: REHD2 6*
Suitable for Stairs: Yes

Date Printed: 17/01/2019

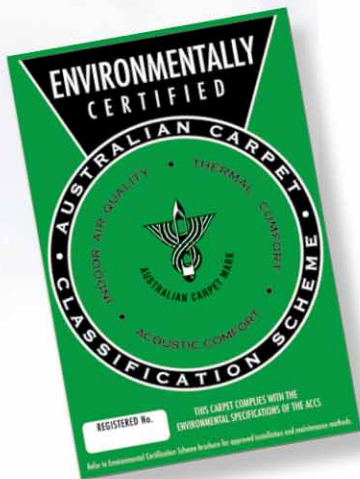

Allan Firth



Allan Firth
Secretary ACCS



Administered by the Carpet Institute of Australia Limited ABN 11 006 829 303
PO Box 7172, St Kilda Road, Melbourne Victoria 8004 Tel: (03) 9804 5559 • Fax: (03) 9804 5560
Email: info@carpetoz.com.au • www.carpetinstitute.com.au

This certificate remains the property of the Carpet Institute of Australia Limited.

Carpet Details:

Company: ABOVE LEFT

Label No: 19004

Licence No: 2001

Office No: 6749

Names:

CROPLANDS

Details:

Awarded Res Grade: REHD2 6*
 Awarded Con Grade: CHD 3*
 Registered On: 17/01/2019
 Active: Yes
 Date In-Active:
 Manufacture Method: Tufted
 Twist Set: N/A
 Dyeing Method: Melt Dyed
 #Colours/Designs: 4-5
 Backing Type: Other
 Felted: N/A
 Spinning System: BCF
 Insect Resist Agent: N/A
 Filament: 20
 Master Product: 17065

Test Results:

Pile Mass g/m² (oz/yd²): 475 (14.0)
 SPM g/m² (oz/yd²): 297 (8.8)
 Stated Pile Height (mm): 3.2
 Minimum Pile Height (mm): 2.5
 Maximum Pile Height (mm): 5.0
 Dynamic Loading Loss (%): 0.0
 Static Loading Loss (%): 0.0
 Tex (g/1000m): 246
 Measured Pile Thickness (mm): 2.6
 Machine Gauge (Tufts/dm): 47.0
 Meas Tufts Perp to Selvedge: 47.9
 Meas Tufts Para to Selvedge: 48.4
 Treated For Soiling Resistance: Yes
 Soil Resist Inhibitor: Yes
 Stain Resist Inhibitor: Yes

Hexapod Scores:

	Texture		Colour		Thickness	
	WA	WA	WA	WA	(mm)	(%)
1500:	4.5	4.5	4.5	4.5	0.5	18.8
8000:	3.0	3.0	4.0	4.0	1.3	19.6

Quality Assurance Test:

Cut Pile (%): 0
 Loop Pile (%): 100
 Panel Assessment Contract: 13
 Panel Assessment Residential: 13
 Suitable For Stairs: Yes
 Tile: Yes SheetGoods: No
 Fibre Signature: NBA:100

ACCS Test:

	Con	Res	Max
SPM/PH Ratio:	12.8	16	16
Volume Density:	14.9	14.9	20
Tuft Density:	9	9	9
Dyn Load:	3.9	3.9	5
Stat Load:	4.1	4.1	5
Soiling Prop:	14	14	16
Abrasion Res:	7.6	7.6	10
Sub Total:	66.3	69.5	81
Panel Assess:	13	13	19
Total:	79.3	82.5	100
Calc Residential Grade:	REHD2	6*	
Calc Contract Grade:	CHD	3*	

Calculations

Pile Height(mm): 2.7
 Tuft Density(per dm²): 2318.4
 GSPM(g/m²): 397.0
 GSPM (abrasive) (g/m²): 275.0
 Soiling Propensity: 12.0 +2.0

OAF Values

OAF: 4.2
 Calc Density (+-5%): 0.11 0.114 0.12
 Base Fibre: NYLON
 Benchmarks:
 RHD1 0 RHD2 3.5
 REHD1 3.5 REHD2 3.5

Environmental Classification:

ECS: Yes
 Level: 4

	Calc	B/M	P/F
Acoustic:	2.6	3	
Thermal:	22.8	15	PASS
VOC:			
TVOC	113		

Notes:

17/01/2019 - Cloned From Master - (17065) by S Elrington.